

ENS-IN-OU RLS Room Code:


Room Name:

ENSUITE - INBOARD / OUTBOARD

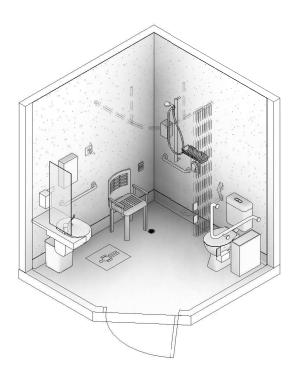


CODE	DESCRIPTION		
ELGP-201.01	GPO: double, wall mounted, horizontal		
ELPR-001	BODY PROTECTED ELECTRICAL AREA		
FIBM-102	MIRROR: fixed, safety glass, frameless		
FIDI-231	DISPENSER: paper towel, wall mounted		
FIDI-256	DISPENSER: soap, wall mounted		
FIDI-281	HOLDER: soap/shampoo, wall mounted		
FIDI-301	DISPENSER: toilet paper, wall mounted		
FIHR-026	HOOK: coat		
FIRT-061.02	TRACK: curtain, shower, L-shaped		
FIRT-101	GRAB RAIL: straight, horizontal		
FIRT-125	GRAB RAIL: toilet, 90 degree		
FIRT-136	GRAB RAIL: toilet, drop down		
FIRT-151	GRAB RAIL: shower, straight, horizontal		
FLSK-021	SKIRTING: vinyl, integral with floor vinyl, coved		
FLSK-021	SKIRTING: vinyl, integral with floor vinyl, coved		
FLVY-114	FLOOR FINISH: vinyl, seamless, non-slip, wet area, barefoot		
FQGE-102	CURTAIN: shower		
FQWS-051	BIN: general waste, 20L		
FQWS-331	BIN: sanitary waste		
HYBA-142	BASIN: type C, handwashing, with integral single shelf		
HYDR-021	DRAIN: floor waste, round		
HYSH-056	SHOWER: hand-held, connection on wall, bracket on vertical wall mounted rail		
HYTP-051	TAPWARE: basin, mixer, fixture mounted		
HYTP-251	TAPWARE: shower, mixer		
HYWC-031	TOILET SUITE: patient		
ITCL-122	BUTTON: patient to staff call, with cancel, wall mounted, wet area		
ITCL-182	BUTTON: nurse call, staff assist, with cancel, wall mounted, wet area		
ITCL-192	BUTTON: nurse call, emergency, with cancel, wall mounted, wet area		
MGAS-043	OUTLET: oxygen (O2), wall mounted		
MGFP-041	FLOWMETER: oxygen		
MMGE-024	CHAIR: shower		
WLFI-011.07	WALL FINISH: vinyl, full height		

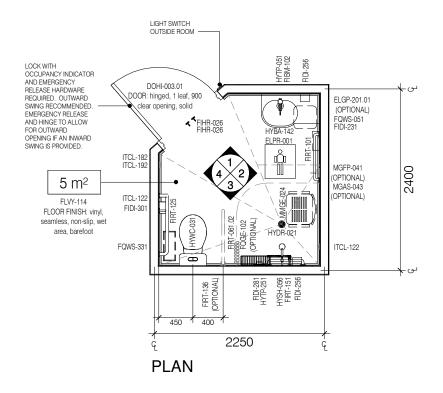



**ELEVATION 1** 

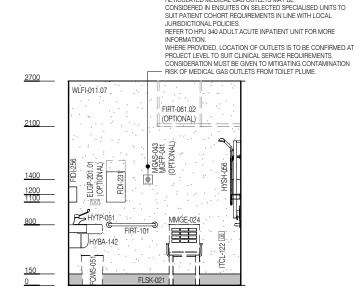

RETICULATED MEDICAL GAS OUTLETS MAY BE

DOWN GRAB RAIL IS DOWN GRAB HAIL IS
DEPENDENT ON PATIENT
COHORT REQUIREMENTS.
WHERE PROVIDED, ENSURE
ADEQUATE IN-WALL SUPPORTS
ARE PROVIDED WLĘ1-01 1.07 FIRT-06,1.02 (OPTIONAL) 2100 1800 1200 1000

OPTIONAL, PROVISION OF DROP

— TYPE, SIZE AND PLACEMENT OF TOILET PAPER DISPENSER IS TO BE CONFIRMED AT PROJECT LEVEL AND MUST BE COORDINATED WITH SELECTED TOILET, GRAB RAILS, ASSISTIVE EQUIPMENT AND NURSE CALL BUTTONS. LARGE DISPENSERS FOR MULTIPLE ROLLS, JUMBO ROLL(S) OR INTERLEAVED TOILET PAPER MAY BE LOCATED IN THE ZONE ABOVE THE GRAB RAIL, WITH THE OPERABLE AREA IDEALLY LOCATED AT THE PRONT/BOTTOM OF THIS ZONE. PLACEMENT AND DEPTH OF DISPENSER MUST NOT COMPROMISE ERGONOMIC USE OF THE GRAB RAIL OR CREATE FINGER ENTRAPMENT RISK WITH ASSISTIVE EQUIPMENT. WLFI-011.07 2100 1600 1500 1400 J.H. 1200

**ELEVATION 2 ELEVATION 3** 

**ELEVATION 4** 

Aust IF G	Guidelines COPYRIGHT 2025 AUSTRALASIAN HEALTH INFRASTRUCTURE ALLIANCE (AHIA)	REV	DESCRIPTION	DATE
		1	FIRST ISSUE	15/12/2025
Australasian Health Facility Guidelines				
	AUSTRALASIAN REALTH INFRASTRUCTURE ALLIANCE (ARIA)			

		SCALE
FOR GI	JIDANCE	1:50 (