Australasian Health Facility Guidelines
Room Layout Sheet

Ensuite - Nested

CARDIAC PROTECTION | **BODY PROTECTION** | HEARING LOOP | RADIATION SHIELDING | MAGNETIC / RF SHIELDING | HEPA FILTRATION | POSITIVE PRESSURE | NEGATIVE PRESSURE

CODE	DESCRIPTION
ELGP-201.01	GPO: double, wall mounted, horizontal
FIBM-102	MIRROR: fixed, safety glass, frameless
FIDI-231	DISPENSER: paper towel, wall mounted
FIDI-256	DISPENSER: soap, wall mounted
FIDI-281	HOLDER: soap/shampoo, wall mounted
FIDI-301	DISPENSER: toilet paper, wall mounted
FIHR-026	HOOK: coat, wall mounted
FIRT-061.02	TRACK: curtain, shower, L-shaped
FIRT-101	GRAB RAIL: straight, horizontal
FIRT-125	GRAB RAIL: toilet, 90 degree
FIRT-136	GRAB RAIL: toilet, drop down
FIRT-151	GRAB RAIL: shower, straight, horizontal
FLSK-021	SKIRTING: vinyl, integral with floor vinyl, coved
FLVY-114	FLOOR FINISH: vinyl, seamless, non-slip, wet area, barefoot
FQGE-102	CURTAIN: shower
FQWS-051	BIN: general waste, 20L
FQWS-331	BIN: sanitary waste
HYBA-142	BASIN: type C, handwashing, with integral single shelf
HYDR-021	DRAIN: floor waste, round
HYSH-056	SHOWER: hand-held, connection on wall, bracket on vertical wall mounted rail
HYTP-051	TAPWARE: basin, mixer, fixture mounted
HYTP-251	TAPWARE: shower, mixer
HYWC-031	TOILET SUITE: patient
ITCL-122	BUTTON: nurse call, patient to staff call, with cancel, wall mounted, wet area
ITCL-182	BUTTON: nurse call, staff assist, with cancel, wall mounted, wet area
ITCL-192	BUTTON: nurse call, emergency, with cancel, wall mounted, wet area
MGAS-043	OUTLET: oxygen (O2), wall mounted
MGFP-041	FLOWMETER: oxygen
MMGE-024	CHAIR: shower
WLFI-011.07	WALL FINISH: vinyl, full height

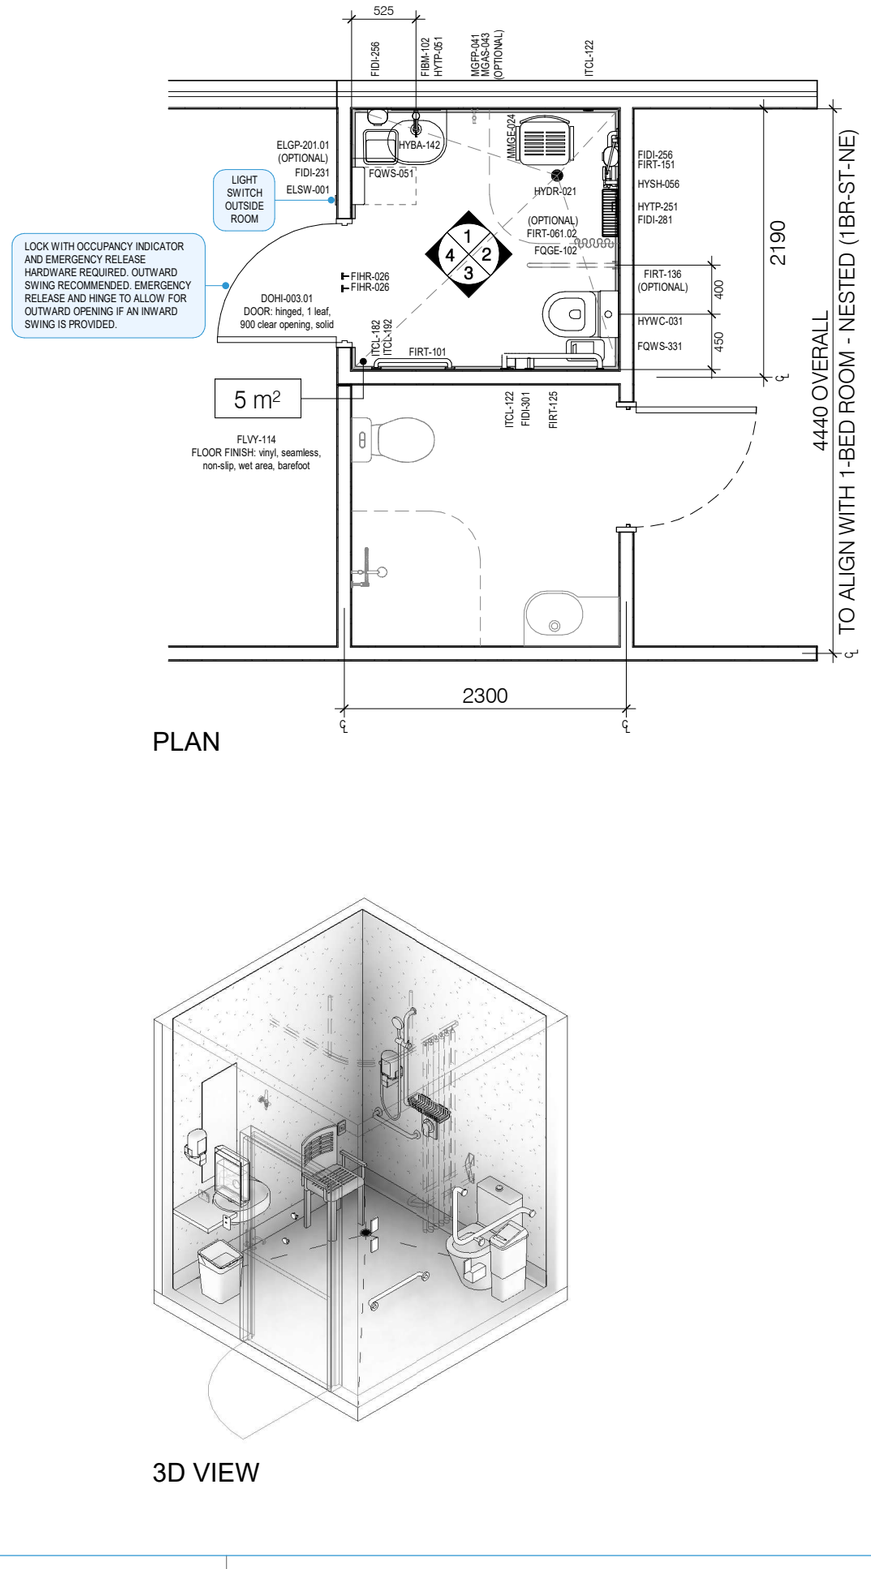

PLAN

3D VIEW

RETICULATED MEDICAL GAS OUTLETS MAY BE CONSIDERED IN ENSUITES ON SELECTED SPECIALISED UNITS TO SUIT PATIENT COHORT REQUIREMENTS IN LINE WITH LOCAL JURISDICTIONAL POLICIES. REFER TO HPU 340 ADULT ACUTE INPATIENT UNIT FOR MORE INFORMATION. WHERE PROVIDED, LOCATION OF OUTLETS IS TO BE CONFIRMED AT PROJECT LEVEL TO SUIT CLINICAL SERVICE REQUIREMENTS. CONSIDERATION MUST BE GIVEN TO MITIGATING CONTAMINATION RISK OF MEDICAL GAS OUTLETS FROM TOILET PLUME.

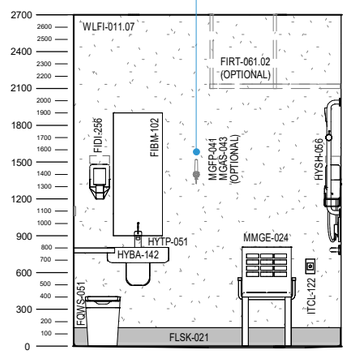

ELEVATION 1

OPTIONAL. PROVISION OF DROP DOWN GRAB RAIL IS DEPENDENT ON PATIENT COHORT REQUIREMENTS. WHERE PROVIDED, ENSURE ADEQUATE IN-WALL SUPPORTS ARE PROVIDED

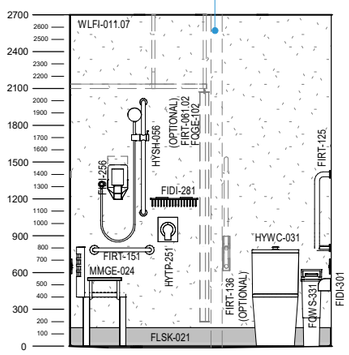

ELEVATION 2

TYPE, SIZE AND PLACEMENT OF TOILET PAPER DISPENSER IS TO BE CONFIRMED AT PROJECT LEVEL AND MUST BE COORDINATED WITH SELECTED TOILET, GRAB RAILS, ASSISTIVE EQUIPMENT AND NURSE CALL BUTTONS. LARGE DISPENSERS FOR MULTIPLE ROLLS, JUMBO ROLL(S) OR INTERLEAVED TOILET PAPER MAY BE LOCATED IN THE ZONE ABOVE THE GRAB RAIL, WITH THE OPERABLE AREA IDEALLY LOCATED AT THE FRONT/BOTTOM OF THIS ZONE. PLACEMENT AND DEPTH OF DISPENSER MUST NOT COMPROMISE ERGONOMIC USE OF THE GRAB RAIL OR CREATE FINGER ENTRAPMENT RISK WITH ASSISTIVE EQUIPMENT.

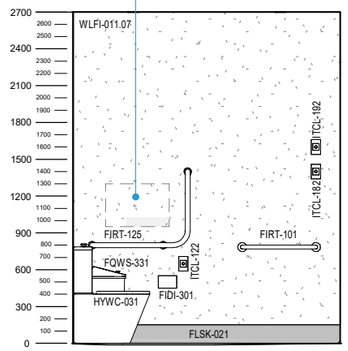

ELEVATION 3

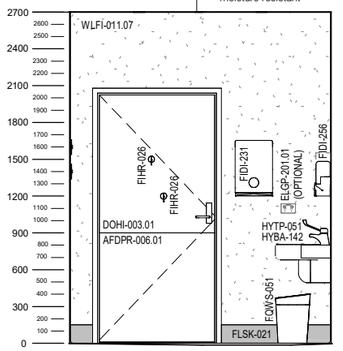

ELEVATION 4

Copyright © 2026 Australasian Health Infrastructure Alliance (AHIA)

Scale

Plan + Elevations 1:50 @ A3 (0 0.5 1 1.5 2 2.5)

Details 1:25 @ A3 (0 0.25 0.5 0.75 1 1.25)

FOR GUIDANCE

Revision	Description	Date
3	Redocumented in new RLS format with panorama	18.11.2026
2	Updated following AHIA review	15.12.2025
1	Historic Revision Placeholder	Date 1

Room Code ENS-NE

Revision 3

Vizylab