





| CODE         | DESCRIPTION   |
|--------------|---|
| AFDFI-026    | DOOR GLAZING FINISH: vision panel, privacy film   |
| AFDPR-001.01 | DOOR PROTECTION: kickplate, to 300H   |
| AHWCY-001    | WINDOW COVERING: blind, roller, single  |
| DOHI-013.08  | DOOR: hinged, 1 leaf, 900 clear opening, solid, anti-ligature, standard vision panel        |
| ELGP-201.01  | GPD: double, wall mounted, horizontal   |
| ELSW-001     | SWITCH: light   |
| FIBM-020     | WHITEBOARD: fixed, magnetic, tamper proof, anti-ligature                                    |
| FIBM-057     | NOTICE BOARD: fixed, fabric covered, tamper proof, anti-ligature                            |
| FLCP-006     | FLOOR FINISH: carpet tiles  |
| FLSK-026     | SKIRTING: vinyl, leather edge   |
| FQBS-111     | CHAIR: visitor, mental health   |
| FQBS-352     | LOUNGE: 2 seat  |
| FQBS-354     | LOUNGE: ottoman   |
| FQDW-104.02  | WORKSTATION: straight, fixed height, 720H, 750D x 1200W                                     |
| FQGE-002     | ARTWORK: wall mounted   |
| ITIN-036     | OUTLET: data, triple RJ45, wall mounted   |
| ITNE-071     | TELEPHONE: handset, desktop   |
| ITNE-101     | COMPUTER: single display screen, central processing unit (CPU), keyboard and mouse, desktop |
| ITSE-061     | BUTTON: security, duress, fixed, wall mounted   |
| ITSE-261     | READER: security, access control, proximity card, wall mounted                              |
| WIFX-156.01  | WINDOW: fixed, external, double glazed, sill at 750H  |
| WLF1-002     | WALL FINISH: paint, clinical areas  |

REQUIREMENTS FOR THE SELECTION OF SUITABLE FINISHES, HARDWARE, FIXTURES AND FITTINGS OF THE TYPE MANUFACTURED AND MARKETED AS TAMPER PROOF AND ANTI-LIGATURE (INCLUDING ANY WEIGHT LIMITS FOR COLLAPSING/BREAKING) MUST BE CONFIRMED AT PROJECT LEVEL BASED ON LOCAL PATIENT SAFETY POLICIES AND DESIGN GUIDANCE, RISK ASSESSMENTS AND CONFIRMATION OF OPERATIONAL MODELS. ALL TAMPER PROOF AND ANTI-LIGATURE ITEMS MUST BE INSTALLED IN ACCORDANCE WITH THEIR MANUFACTURER'S INSTRUCTIONS.

LEAKAGE PROTECTION DEVICES (LPDs) SUCH AS RESIDUAL CURRENT DEVICES (RCDs) THAT COVER THE ELECTRICAL SERVICES WITHIN THIS SPACE ARE ASSUMED TO BE PROVIDED IN A CENTRAL AREA WITHIN THE UNIT (E.G. AT A STAFF STATION). LOCATION TO BE CONFIRMED AT PROJECT LEVEL.

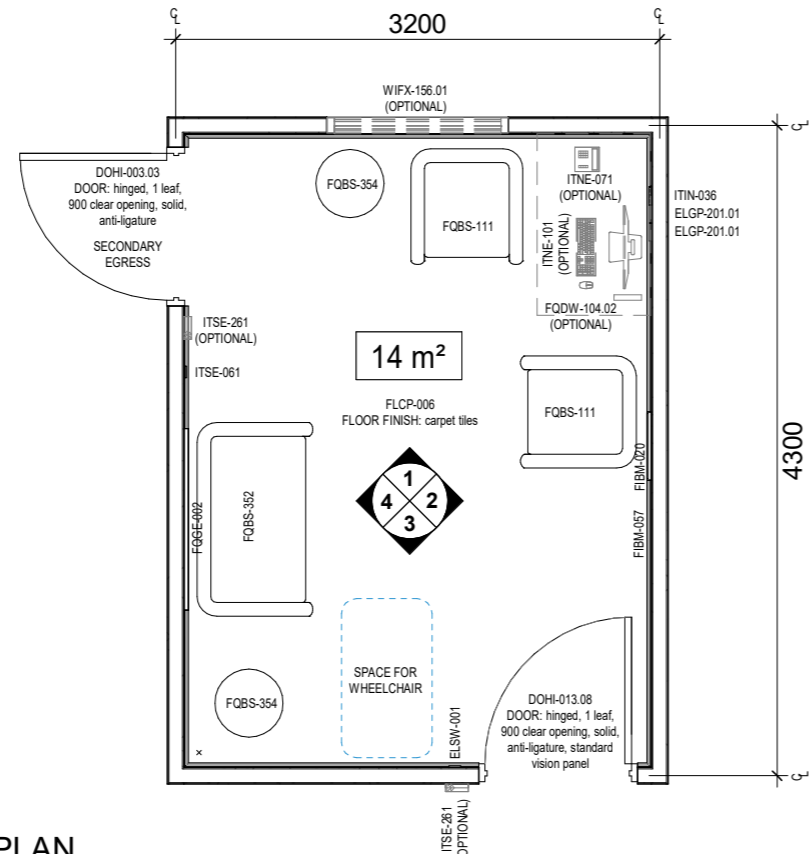


PLAN

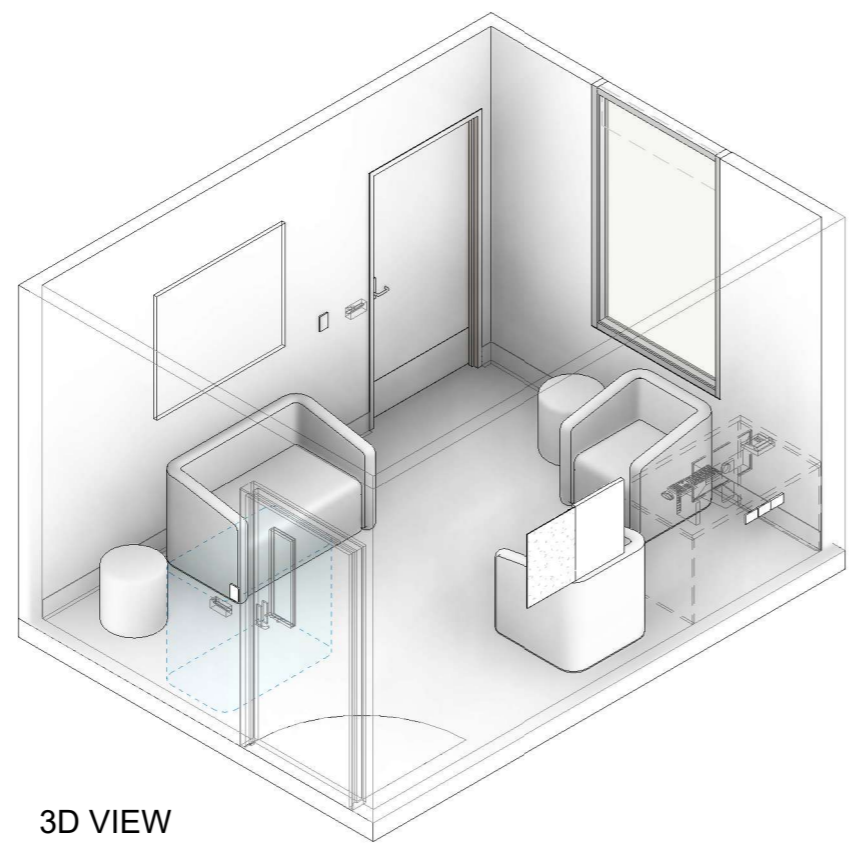


3D VIEW

NATURAL LIGHT AND EXTERNAL OUTLOOK IS DESIRABLE. CONSIDER PLACEMENT OF WINDOWS AND ROOM ORIENTATION TO SUIT PRIVACY REQUIREMENTS. ALL GLAZING IS TO BE GRADE A SAFETY GLASS AND COMPLY WITH AS/NZS 2208 AND AS 1288. TOUGHENED AND LAMINATED GLASS WITH A STRUCTURAL INTERLAYER IS RECOMMENDED. ADDITIONAL REQUIREMENTS FOR GLAZING ARE TO BE CONFIRMED AT PROJECT LEVEL TO SUIT THE SPECIFIC MENTAL HEALTH ENVIRONMENT (i.e. NON-ACUTE, ACUTE, INTENSIVE CARE).

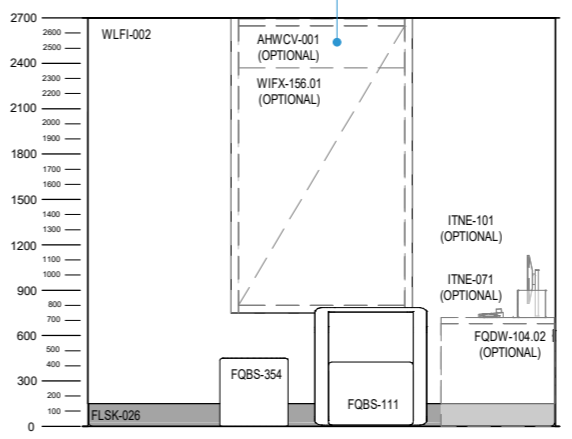


ELEVATION 1

PROVISION OF A WORKSTATION IS DEPENDENT ON SERVICE REQUIREMENTS (eg. NEED TO UNDERTAKE COMPUTER BASED ASSESSMENTS WITHIN THIS ROOM). THE IMPACT ON THE ARRANGEMENT OF FURNITURE WHEN A WORKSTATION IS INCLUDED MUST BE CONSIDERED TO ENSURE THE SPACE SUPPORTS A POSITIVE DYNAMIC BETWEEN STAFF AND CONSUMERS AND ENCOURAGES PARTICIPATION BY CONSUMERS AS EQUAL PARTNERS IN THEIR CARE.

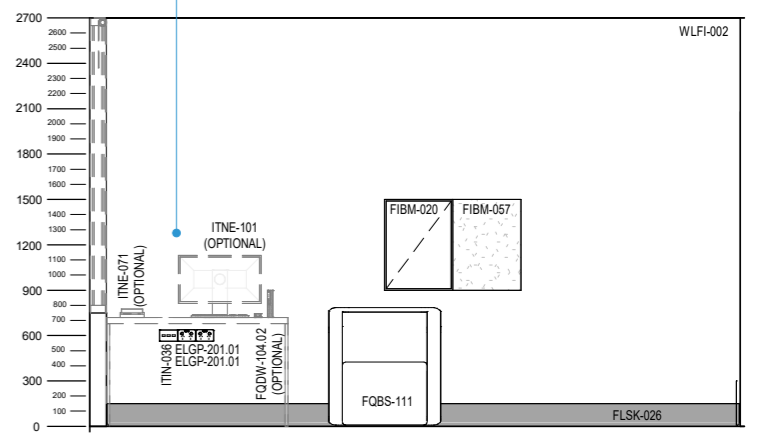


ELEVATION 2

IT IS RECOMMENDED THAT THE DOOR SET IS SELECTED AS A FULL ASSEMBLY TO ENSURE THE LEAF, FRAME, AND HARDWARE ARE COORDINATED AND MEET ALL TAMPER PROOF, ANTI-LIGATURE AND ANTI-BARRICADE REQUIREMENTS WHEN USED TOGETHER. INCLUSION AND SIZE OF A VISION PANEL IS TO BE CONFIRMED TO SUIT SERVICE REQUIREMENTS. PRIVACY FILM MAY BE APPLIED AS REQUIRED.

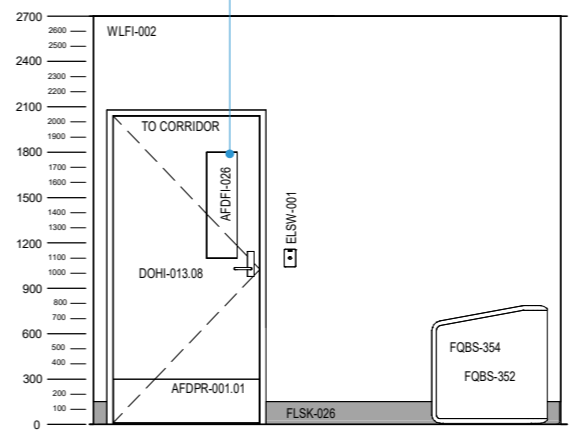

ELEVATION 3

WHERE IT IS DETERMINED THAT A TAMPER PROOF AND ANTI-LIGATURE FINISH IS REQUIRED, A FLUSH SET CEILING IS TO BE PROVIDED.

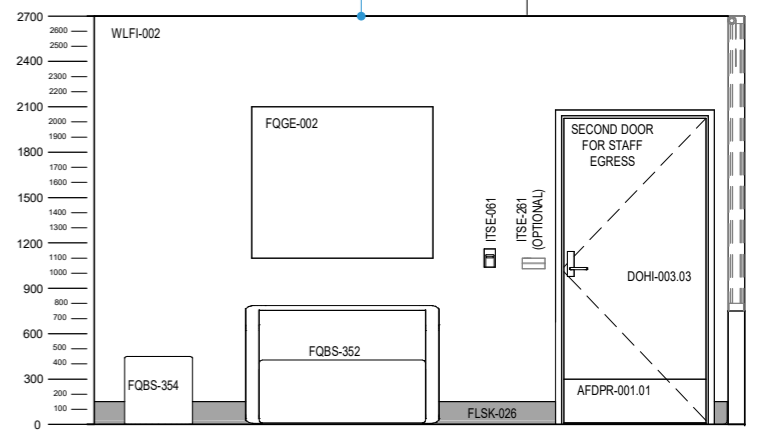

ELEVATION 4

| Revision | Description                                  | Date       |
|----------|--|------------|
| 3        | Redocumented in new RLS format with panorama | 31.03.2026 |
| 2        | Updated following AHIA review                | 20.08.2025 |
| 1        | First Issue                                  | 02.07.2018 |

| Room Code |
|-----------|
| INTV-MH   |
| Revision  |
| 3         |

