
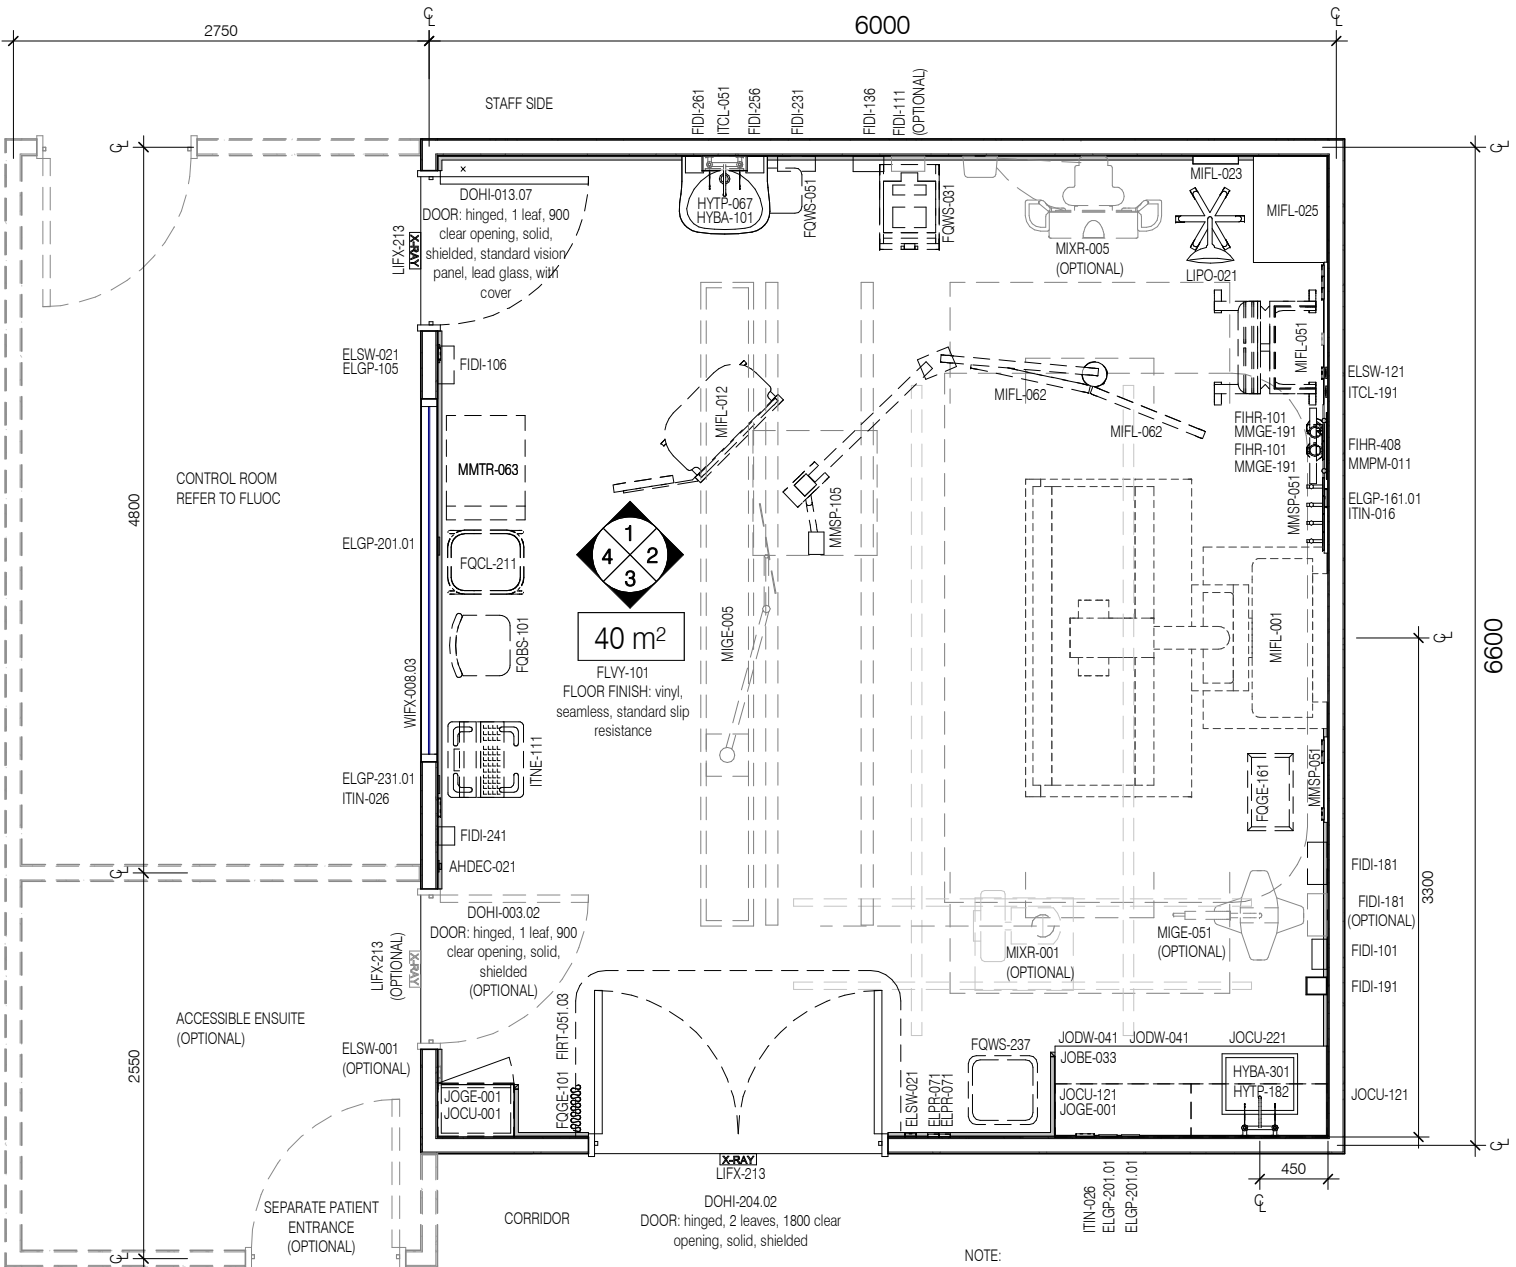


AUSTRALASIAN HFG STANDARD COMPONENTS

Room Layout Sheet

RLS Room Code: FLUO

Room Name: FLUOROSCOPY ROOM

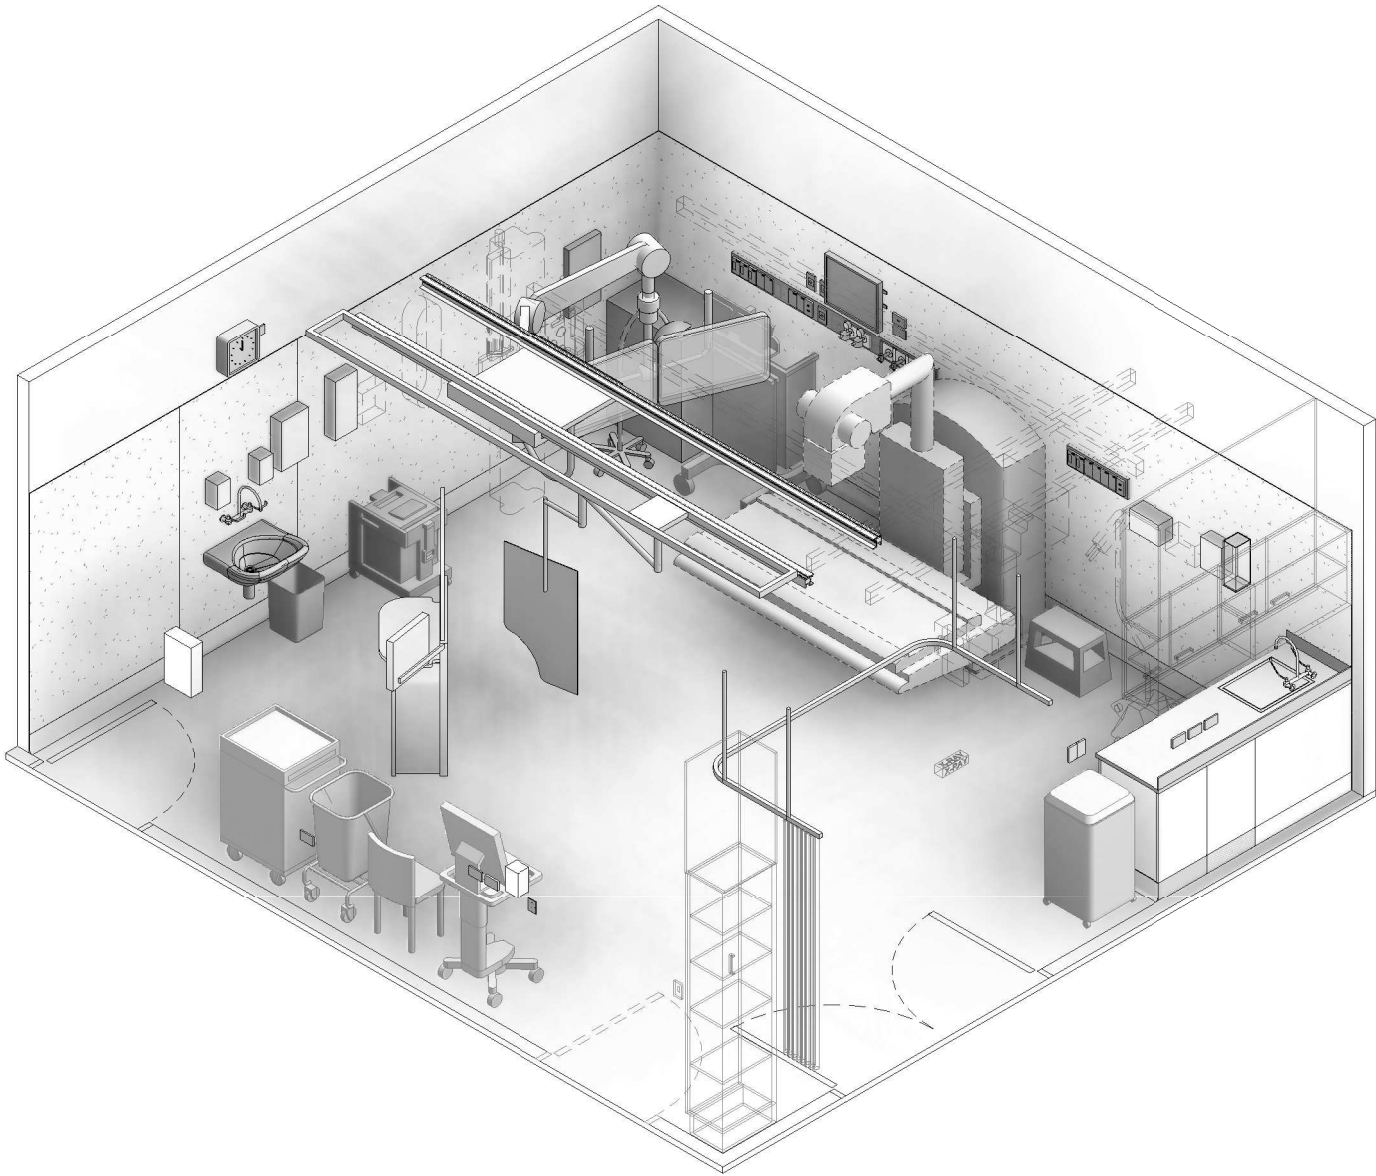

PLAN

NOTE:
NOTHING SHOULD BE LOCATED WITHIN MACHINE SPACE AS IT MAY BE CRUSHED WHEN THE TABLE IS TILTED. FLOOR MARKING TO DENOTE CLEAR ZONE.

CODE	DESCRIPTION
AFDPR-006.01	DOOR PROTECTION: plate, to 900 AFFL
AHDEC-021	BUTTON: door release, remote activation, wall mounted
ELGP-101.01	GPO: single, wall mounted, horizontal
ELGP-105	GPO: single, wall mounted, cleaner
ELGP-116	GPO: single, on service panel
ELGP-146	GPO: single, emergency power, on service panel
ELGP-161.01	GPO: single, UPS, wall mounted, horizontal
ELGP-176	GPO: single, UPS, on service panel
ELGP-201.01	GPO: double, wall mounted, horizontal
ELGP-231.01	GPO: double, emergency power, wall mounted, horizontal
ELPR-033	PANEL: UPS status indicator, on services panel
ELPR-071	RCD: residual current device, wall mounted
ELPR-073	RCD: residual current device, on services panel
ELSW-001	SWITCH: light
ELSW-021	SWITCH: light, dimmer
ELSW-121	BUTTON: emergency stop, wall mounted
FIDI-101	DISPENSER: PPE, disposable masks, wall mounted
FIDI-106	DISPENSER: PPE, disposable gloves, wall mounted
FIDI-111	DISPENSER: PPE, disposable gowns/aprons, wall mounted
FIDI-136	HOLDER: PPE, lead goggles, wall mounted
FIDI-181	DISPENSER: cleaning wipes, wall mounted
FIDI-191	DISPENSER: emesis bags, wall mounted

CODE	DESCRIPTION
FIDI-231	DISPENSER: paper towel, wall mounted
FIDI-241	DISPENSER: alcohol-based hand rub, wall mounted
FIDI-256	DISPENSER: soap, wall mounted
FIDI-261	DISPENSER: soap, antiseptic, wall mounted
FIHR-101	BRACKET: suction bottle, wall mounted
FIHR-408	BRACKET: patient monitor, articulated, wall mounted
FIRT-051.03	TRACK: curtain, privacy, U-shaped
FLSK-021	SKIRTING: vinyl, integral with floor vinyl, coved
FLVY-101	FLOOR FINISH: vinyl, seamless, standard slip resistance
FOBS-101	CHAIR: visitor, clinical areas
FQCL-211	LINEN CARRIER: dirty, single skip
FQGE-101	CURTAIN: privacy screen
FQGE-161	STOOL: step
FQWS-031	CART: sharps bin, clinical
FQWS-051	BIN: general waste, 20L
FQWS-237	BIN: clinical waste, 120L
HYBA-101	BASIN: type A, handwashing
HYBA-301	SINK: single bowl
HYTP-067	TAPWARE: basin, tap set, wall mounted, lever handles
HYTP-182	TAPWARE: sink, tap set, wall mounted, lever handles
ITCL-051	CLOCK: electric, analogue
ITCL-183	BUTTON: staff assist, with cancel, on services panel

CODE	DESCRIPTION
ITCL-191	BUTTON: emergency, with cancel, wall mounted
ITIN-016	OUTLET: data, single RJ45, wall mounted
ITIN-025	OUTLET: data, double RJ45, on services panel
ITIN-026	OUTLET: data, double RJ45, wall mounted
ITNE-111	COMPUTER: workstation on wheels (WOW), medical grade, all-in-one computer, keyboard and mouse, on cart
JOBE-033	BENCH: 600D, stainless steel lipped
JOCU-001	CUPBOARD: tall, single door
JOCU-121	CUPBOARD: wall mounted, double door
JOCU-221	CUPBOARD: under bench, double door
JODW-041	DRAWER UNIT: under bench, 4 drawers, equal
JOGE-001	BULKHEAD: joinery
LIFX-213	LIGHT: illuminated sign, x-ray in use
LIPO-021	LIGHT: examination, articulated, mobile
MGAS-022	OUTLET: medical air, on services panel
MGAS-032	OUTLET: nitrous oxide (N2O), on services panel
MGAS-042	OUTLET: oxygen (O2), on services panel
MGAS-052	OUTLET: scavenge, on services panel
MGAS-062	OUTLET: suction, on services panel
MGFP-021	FLOWMETER: medical air
MGFP-041	FLOWMETER: oxygen
MGFP-061	ADAPTER: suction

CODE	DESCRIPTION
MIFL-001	IMAGING DEVICE: fluoroscopy/screening, with patient table
MIFL-012	CONTROL CONSOLE: fluoroscopy/screening, single display screen, control unit, mobile
MIFL-023	BOARD: distribution, fluoroscopy/screening
MIFL-025	GENERATOR: fluoroscopy/screening
MIFL-051	RACK: fluoroscopy/screening, table mounted shields, mobile
MIFL-062	DISPLAY SCREEN: fluoroscopy/screening, pendant mounted
MIGE-005	SHIELD: radiation, pendant mounted
MIGE-051	INJECTOR: contrast, pedestal
MIXR-001	IMAGING DEVICE: general x-ray, tube head, ceiling suspended
MIXR-005	IMAGING DEVICE: general x-ray, wall bucky, fixed
MMGE-191	CANNISTER: suction bottle
MMPM-011	MONITOR: patient, medium acuity
MMSP-051	MEDICAL SERVICES PANEL: wall mounted
MMSP-105	MEDICAL SERVICES PENDANT: single arm, dual display screens
MMTR-063	TROLLEY: dressing, 750W x 490D x 900H nom
WIFX-008.03	WINDOW: fixed, internal, single glazed, sill at 1050H, shielded, lead glass
WLFI-002	WALL FINISH: paint, clinical areas
WLFI-011.06	WALL FINISH: vinyl, to 2100 AFFL
WLFI-101	SPLASHBACK: vinyl

REV	DESCRIPTION	DATE
2	GENERAL UPDATE FOLLOWING ERG REVIEW	15/05/2025



FOR GUIDANCE

SCALE	RLS Room Code	REV
1 : 50 @ A3	FLUO	2

RLS Room Code: FLUO



FLUOROSCOPY ROOM



CODE	DESCRIPTION
MIFL-001	IMAGING DEVICE: fluoroscopy/screening, with patient table
MIFL-012	CONTROL CONSOLE: fluoroscopy/screening, single display screen, control unit, mobile
MIFL-023	BOARD: distribution, fluoroscopy/screening
MIFL-025	GENERATOR: fluoroscopy/screening
MIFL-051	RACK: fluoroscopy/screening, table mounted shields, mobile
MIFL-062	DISPLAY SCREEN: fluoroscopy/screening, pendant mounted
MIGE-005	SHIELD: radiation, pendant mounted
MIGE-051	INJECTOR: contrast, pedestal
MIXR-001	IMAGING DEVICE: general x-ray, tube head, ceiling suspended
MIXR-005	IMAGING DEVICE: general x-ray, wall bucky, fixed
MMGE-191	CANNISTER: suction bottle
MMPM-011	MONITOR: patient, medium acuity
MMSP-051	MEDICAL SERVICES PANEL: wall mounted
MMSP-105	MEDICAL SERVICES PENDANT: single arm, dual display screens
MMTR-063	TROLLEY: dressing, 750W x 490D x 900H nom
WIFX-008.03	WINDOW: fixed, internal, single glazed, sill at 1050H, shielded, lead glass
WLFI-002	WALL FINISH: paint, clinical areas
WLFI-011.06	WALL FINISH: vinyl, to 2100 AFFL
WLFI-101	SPLASHBACK: vinyl

 AustHFG Australasian Health Facility Guidelines COPYRIGHT 2025 AUSTRALASIAN HEALTH INFRASTRUCTURE ALLIANCE (AHIA)	REV	DESCRIPTION	DATE	FOR GUIDANCE	SCALE	RLS Room Code	REV
	2	GENERAL UPDATE FOLLOWING ERG REVIEW	15/05/2025		1 : 50 @ A3	FLUO	2