

RLS Room Code:


REPW

Room Name:



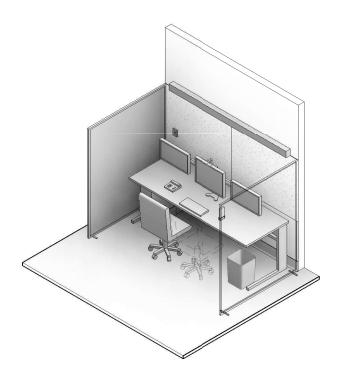


CODE	DESCRIPTION			
ELGP-201.01	GPO: double, wall mounted, horizontal			
ELGP-231.01	GPO: double, emergency power, wall mounted, horizontal			
ELSW-021	SWITCH: light, dimmer			
FIHR-201	BRACKET: central processing unit (CPU), under bench/desk			
FIHR-231	BRACKET: computer display screen, triple, articulated, bench/dest mounted			
FLCP-006	FLOOR FINISH: carpet tiles			
FLSK-026	SKIRTING: vinyl, feather edge			
FQBS-171	CHAIR: office, ergonomic			
FQDW-165.07	WORKSTATION: straight, adjustable height, 720H nom, 800D x 2200W			
FQGE-109	SCREEN: privacy, acoustic, floor standing			
FQWS-051	BIN: general waste, 20L			
ITIN-026	OUTLET: data, double RJ45, wall mounted			
ITIN-066	OUTLET: data, HDMI, wall mounted			
ITIN-171	DESK BOX: power and data outlets, soft-wired, surface mounted			
ITNE-071	TELEPHONE: handset, desktop			
ITNE-153	COMPUTER: central processing unit (CPU), PACS			
ITNE-171	DISPLAY SCREEN: computer			
ITNE-172	DISPLAY SCREEN: computer, PACS			
ITNE-201	INPUT DEVICE: keyboard and mouse			
ITNE-241	RECORDER: dictation			
ITNE-251	CAMERA: webcam, display screen mounted			
LIFX-079	LIGHT: linear, indirect, wall mounted			
WLFI-002	WALL FINISH: paint, clinical areas			
WLFI-202	ACOUSTIC TREATMENT: wall panel, prefinished			

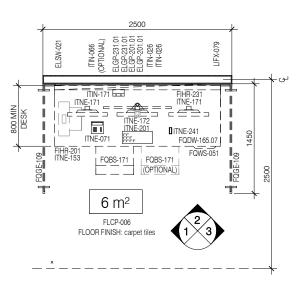


PLAN

NOTE: THIS STANDARD COMPONENT IS INTENDED FOR USE AS A MODULE IN AN OPEN PLAN ARRANGEMENT WITH MORE THAN ONE WORKSTATION. THE NUMBER OF WORKSTATIONS WILL BE DETERMINED AT PROJECT LEVEL TO SUIT SERVICE REQUIREMENTS AND STAFFING PROFILE. SHARED ELEMENTS, SUCH AS LARGE MONITORS FOR COLLABORATIVE TEAM VIEWING, AN ANNUNCIATOR FOR NURSE CALLS, WHITEBOARDS AND STORAGE FOR STAFF PROPERTY AND STATIONERY, IS ALLOCATED SEPARATELY TO BE SHARED BETWEEN MULTIPLE WORKSTATIONS.


NOTE: DEPENDING ON THE OVERALL LAYOUT WHEN WORKSTATION MODULES ARE COMBINED, SERVICES MAY BE WALL MOUNTED FOR EACH INDIVIDUAL WORKSTATION OR SOFT-WIRED DESKTOP SERVICES AND CABLE TRAYS MAY BE PROVIDED AND CONNECTED TO A CENTRAL POINT WHERE SERVICES ARE WALL MOUNTED OR DELIVERED VIA AN UMBILICAL OR POLE FROM THE CEILING OR







NOTE: LIGHTING FIXTURES ARE INDICATIVE. THE OVERALL COMBINATION OF DIMMABLE GENERAL ROOM LIGHTING, DIMMABLE INDIRECT LIGHTING (WALL AND/OR CEILING FIXTURES), AND THE USE OF FFE ITEMS SUCH AS BACK LIT MONITORS AND KEYBOARDS IS TO BE ASSESSED TO ENSURE THE SPACE. MEETS REQUIREMENTS FOR PERFORMANCE OF REVIEWING AND REPORTING TASKS

NOTE: DISPLAY SCREENS SHOWN ON DESK MOUNTED BRACKETS MAY BE WALL MOUNTED. ENSURE APPROPRIATE IN-WALL SUPPORT IS PROVIDED WHERE DISPLAY SCREENS ARE TO BE WALL

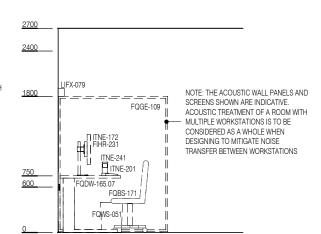







WORKSTATION LAYOUT BACK TO BACK

WORKSTATION LAYOUT BACK TO WALL

WORKSTATION LAYOUT BACK TO STORAGE

ELEVATION 1

ELEVATION 2

ELEVATION 3

PLAN - WORKSTATION CONFIGURATIONS

Australasian Health Facility Guidelin)
---------------------------------------	----------

	REV	DESCRIPTION	DATE
	2	GENERAL UPDATE FOLLOWING ERG REVIEW	15/05/2025
COPYRIGHT 2025			
AUSTRALASIAN HEALTH INFRASTRUCTURE ALLIANCE (AHIA)			

SCALE	RLS Room Code	REV
: 50 @ A3	REPW	2